



水務署

Water Supplies Department

香港灣仔告士打道七號入境事務大樓
Immigration Tower, 7 Gloucester Road, Hong Kong

電子郵遞
e-mail wsdinfo@wsd.gov.hk

電話
Telephone 2829 4367

圖文傳真
Facsimile 2824 0578

檔號
Reference (4) in WSD 3321/14 Pt.1 T/J(155)

22 September 2014

Approval of "PEGLER" Equilibrium Float Valves

Your letter dated 13 August 2014 and subsequent submission received on 29 August 2014 refer.

It is noted that the fittings described below have been accepted by the United Kingdom Water Regulations Advisory Scheme (WRAS) to have complied with the requirements of the United Kingdom Water Supply (Water Fittings) Regulations / Scottish Water Byelaws when correctly installed.

Name of Manufacturer: Pegler Yorkshire Group Ltd.

Country of Origin: UK

Brand: Pegler

Details of Fittings: "901" range of equilibrium float valves with brass or gunmetal bodies and EPDM seals. Maximum working pressure 10.0 bar. Cold water use only.

Size: 901 Brass ½" - 1" BSP
901 Gunmetal 1¼" - 6" BSP

Model: 901 range

Marking: 901 Brass (1/2" - 1"): Pegler, 901 & England on body
901 Gunmetal (1 1/4" - 6"): Pegler, 901, size & England
on body

WRAS Approval Number: 1305028

Installation Requirements: R001, R280, R390

In view of the acceptance by WRAS, I have no objection to the use of the said fittings in fresh water supply plumbing systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following installation requirements –

“Installation shall comply with the ‘Installation Requirements & Notes’ of the WRAS’s approval letter concerned.”

A condition of this acceptance is that the fittings to be installed should be replicas of the samples certified by WRAS and no modification should be made to the fittings. This acceptance may be withdrawn at any time if the standard of the fittings installed fails to meet that of the approved samples or if the fittings are found to be unsuitable for use in fresh water supply plumbing systems.

For the use of the fitting in any project, the Acceptance Reference Number at the bottom of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.


Should you have any enquiries, please contact our Engineer Mr. Ken H CHAN at tel. no. 2829 4453.

Yours faithfully,



(LAM Ching Man)
for Water Authority

c.c. WSD 3321/1/82] - without catalogue
E/CS(TS)1]

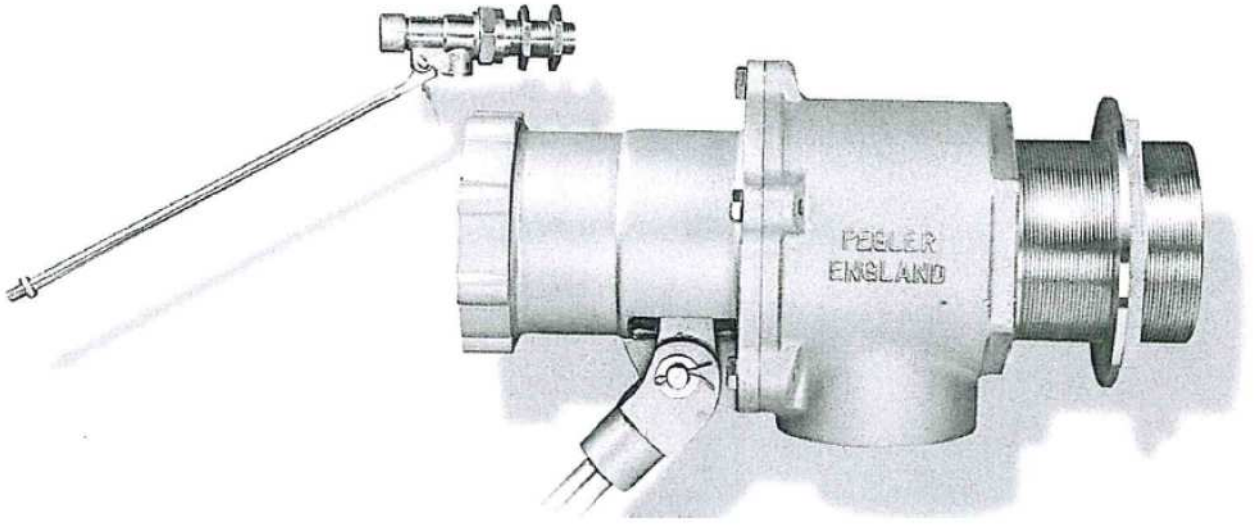

901